

Fig. 1

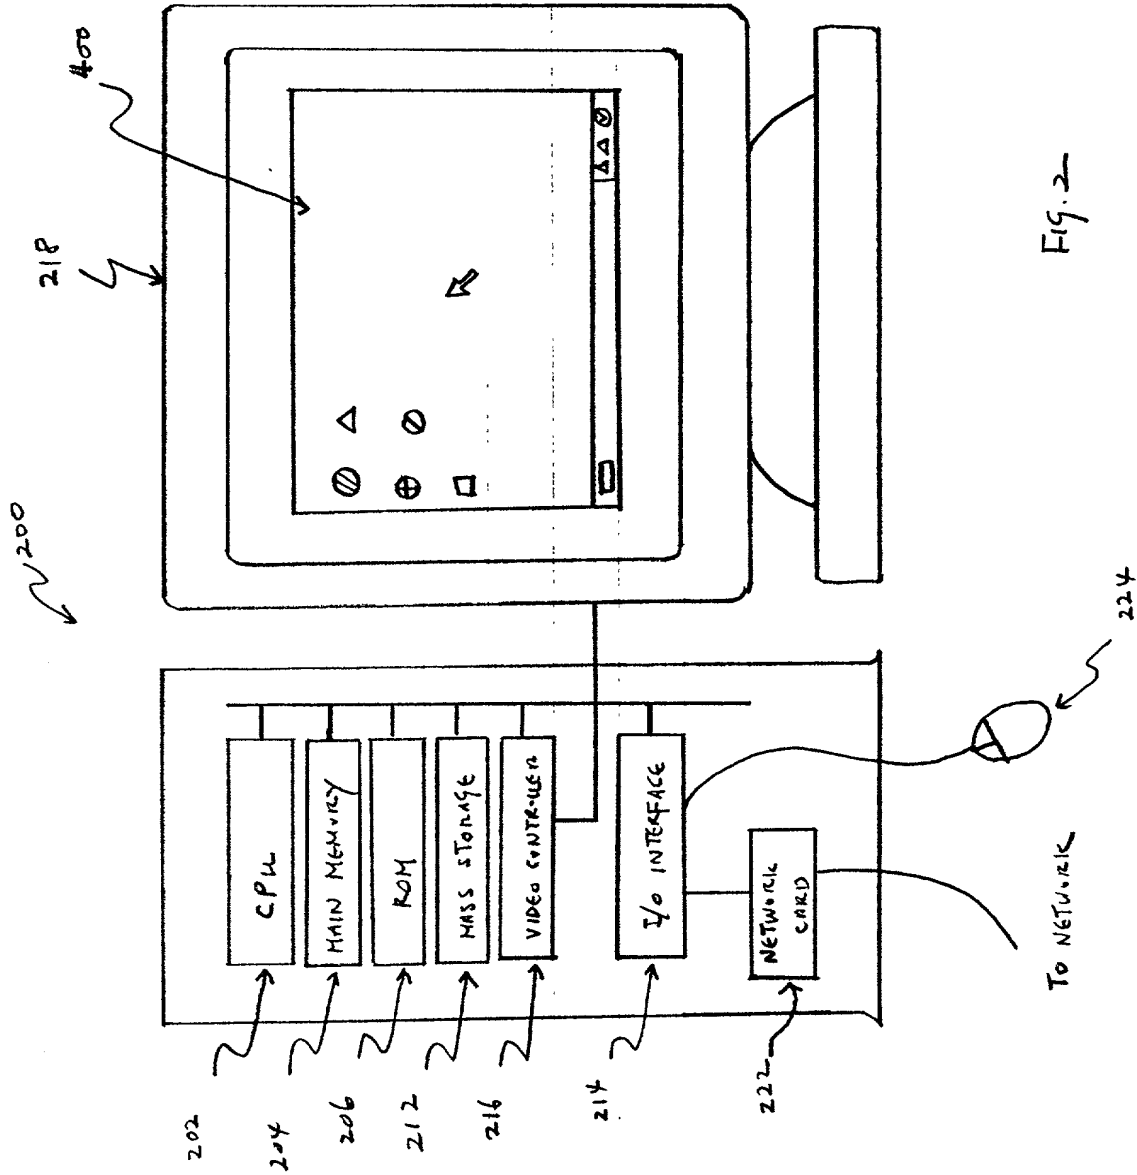


FIG. 2

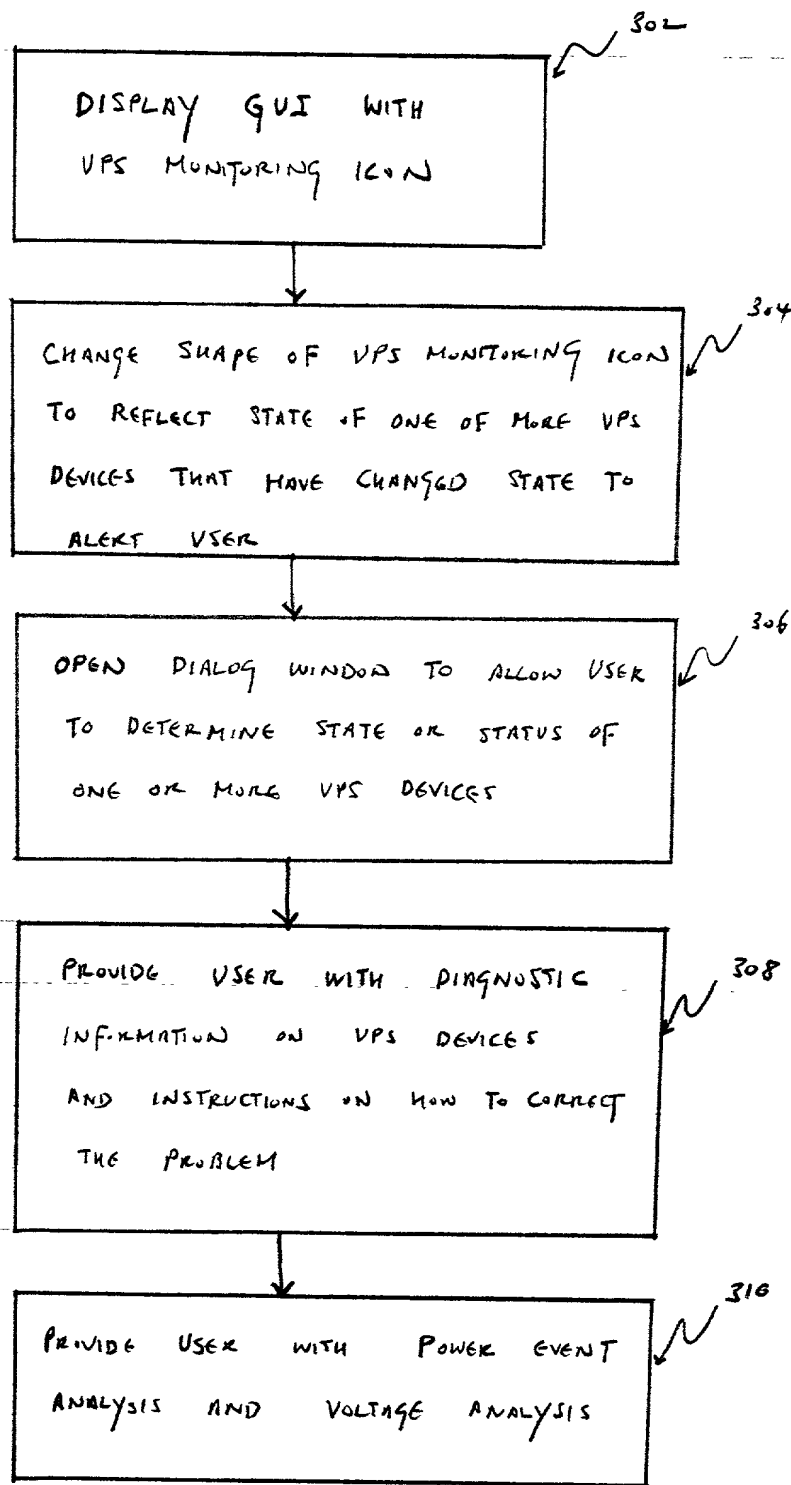


Fig 3



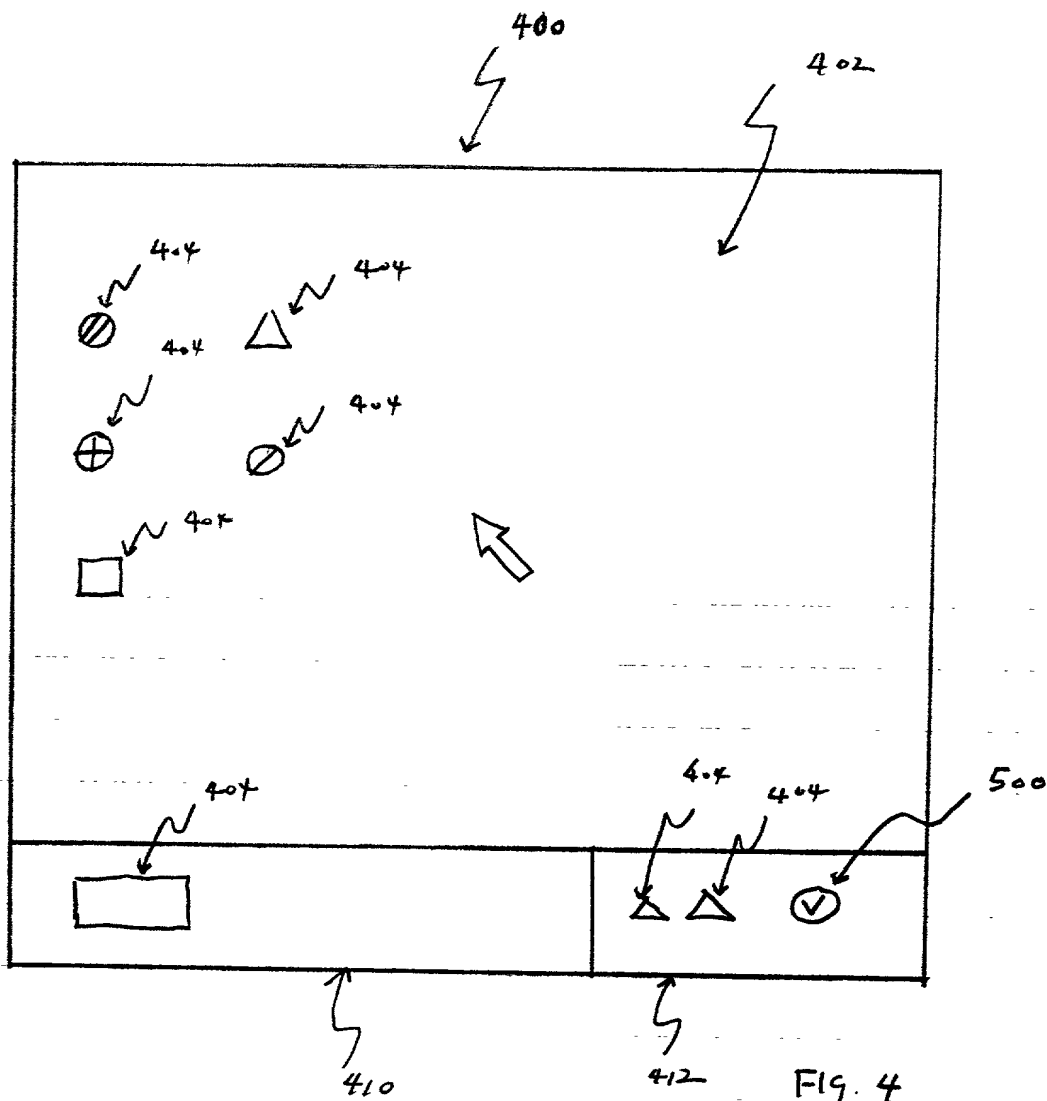



Fig. 4




- NORMAL



- CRITICAL



- WARNING



- UNKNOWN

Fig. 5

FIG. 6

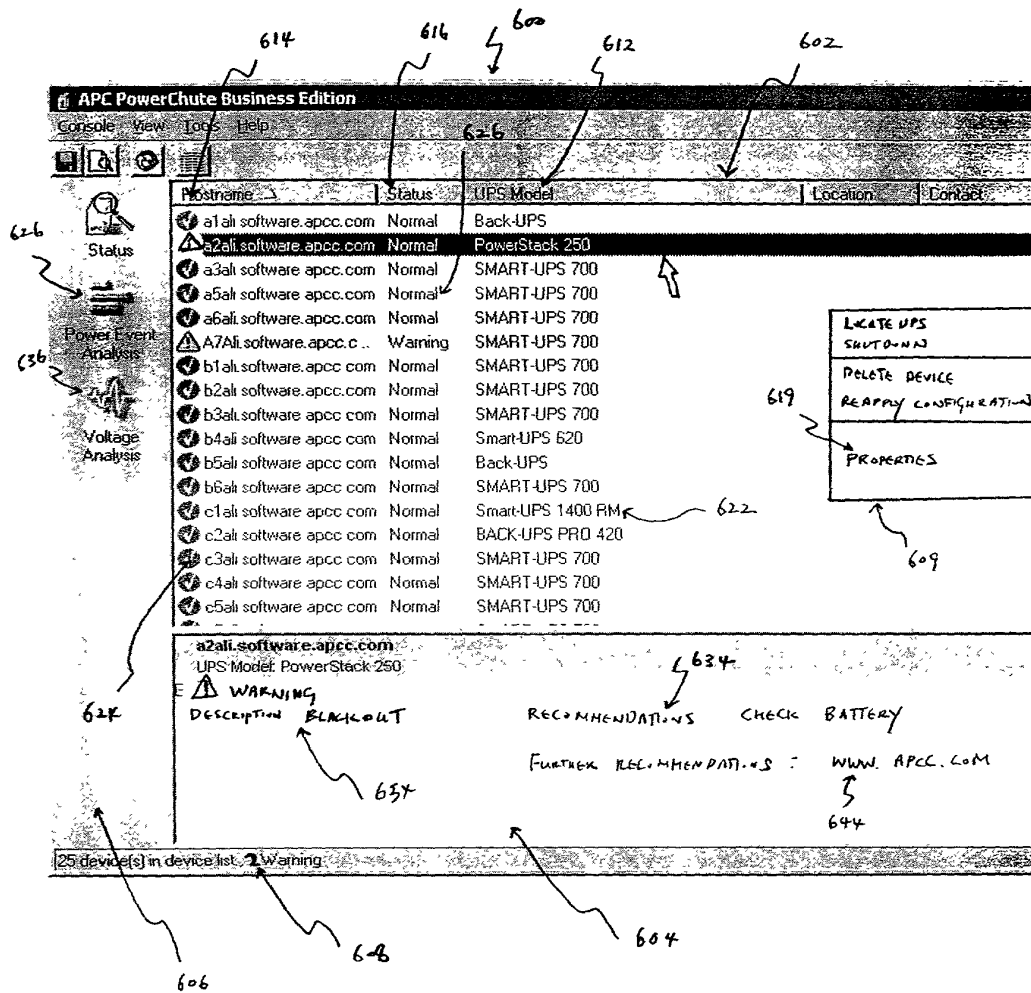


FIG 6

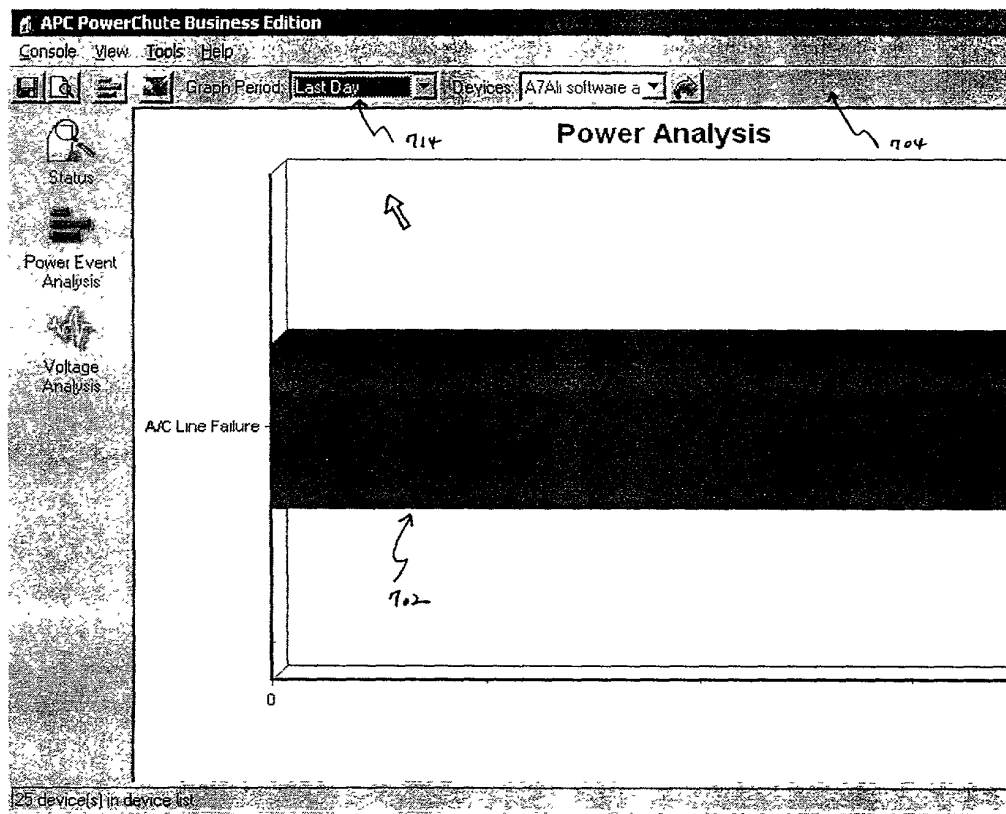


Fig 7

APC PowerChute Business Edition

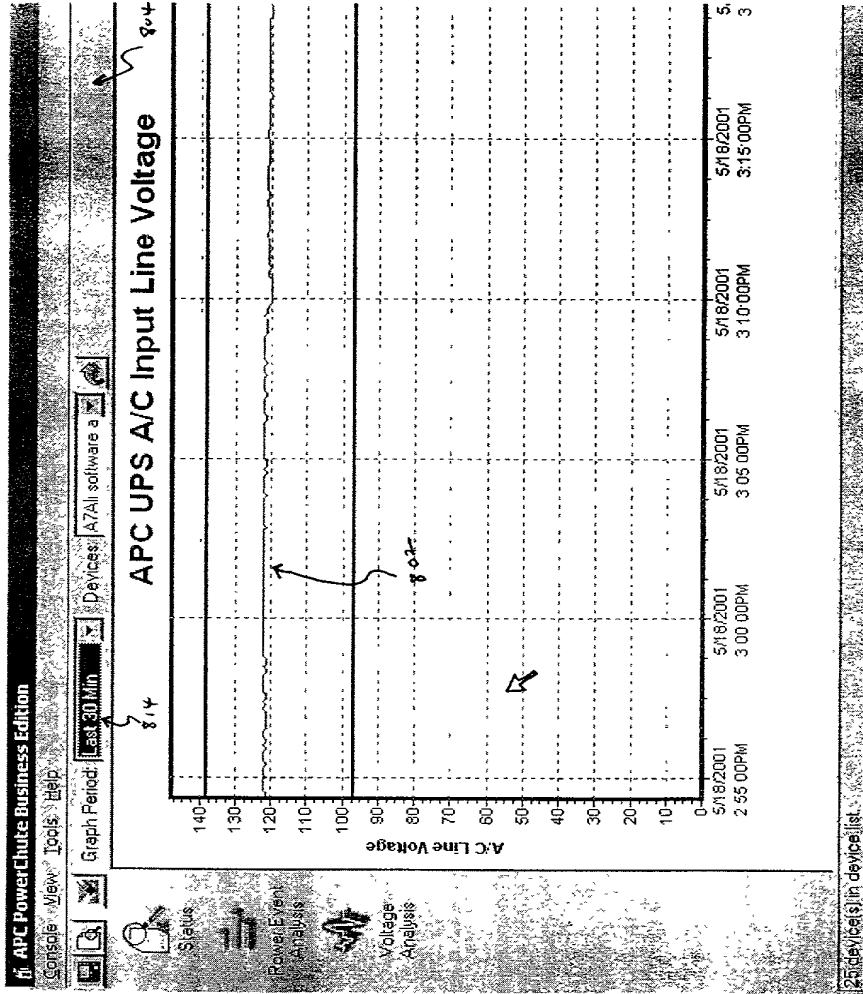


Fig. 8

8.00



Device Properties

A7All software.apco.com

Summary

General

- Summary
- Admin Information
- UPS Identification
- UPS Status
- Battery Status
- Power Parameters
- Shutdown
- Diagnostics
- Log Files
- Communications

Host Information

IP Address: 159.215.15.116

Agent Version: 6.0 Pre-Alpha 2

Operating System: Windows 2000 SP0

UPS Information

UPS Model: SMART-UPS 700

Serial Number: NS0042141978

Manufacture Date: 10/13/2000

Firmware Revision: 50.11.D

Battery Replaced: 3/1/2004

Apply Close Help

Show advanced items

700

Fig. 9

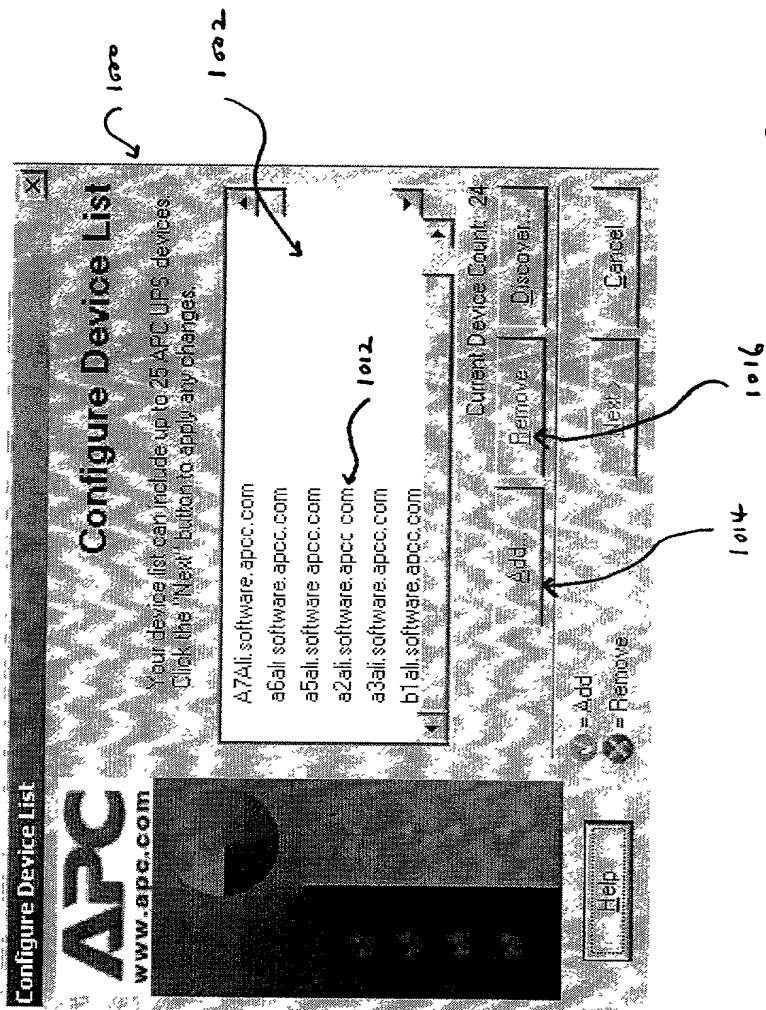


FIG. 10

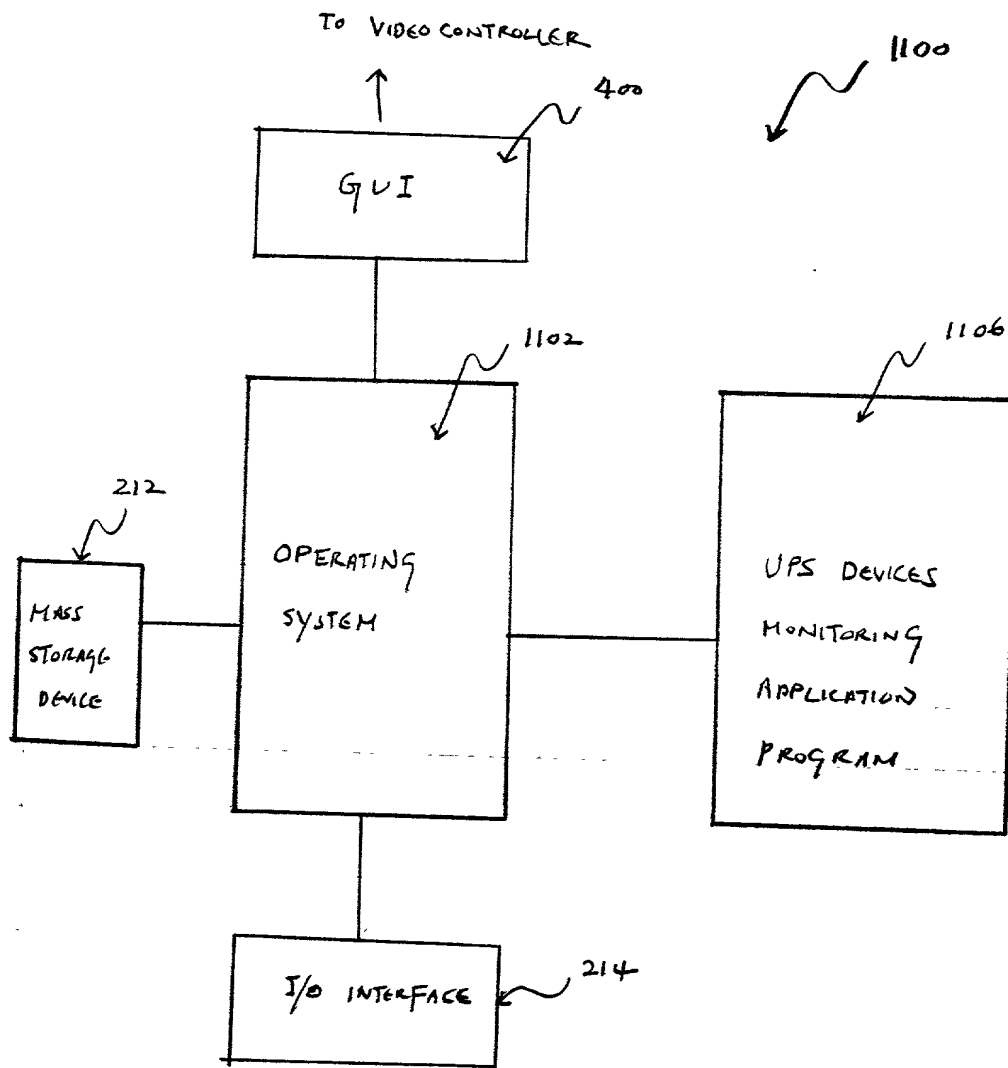


FIG. 11